

# Test Certificate No. 120000442.70-02

2nd Copy

## Contracting Party

DORMA GmbH & Co. KG  
 Breckerfelderstr. 42-48  
 D-58256 Ennepetal

## Date of order:

16.01.2006

## Date of test:

11.10.2006 to  
 10.01.2007

## Assignment

Testing of controlled door closing devices (door closer) in accordance with DIN EN 1154: 1997-05 (Ref. No. EN 1154: 1996 D). The tests are to be including the additional requirements according to annex A of DIN EN 1154.

## Description of Samples

Overhead door closer with hydraulic damping, second closing area, adjustable backcheck, adjustable second closing area, latch and projecting arm.

## Description of the Test and Test Results

See test report No. 120000442.70-01.

## Evaluation of the Test Results

The following door closers fulfil the requirements of the DIN EN 1154.

Door leaf fixing corresponding with appendix 1.

They are classified as follows in accordance with sec. 4 of DIN EN 1154:

Product	Additional functions	Classification key					
DORMA TS 73 EN 1-4 BCA/DC	Backcheck and delayed closing	4	8	1 4	1	1	3


Dortmund, April , 24th 2007


By order



H. Jansen  
 Head of the test  
 laboratory



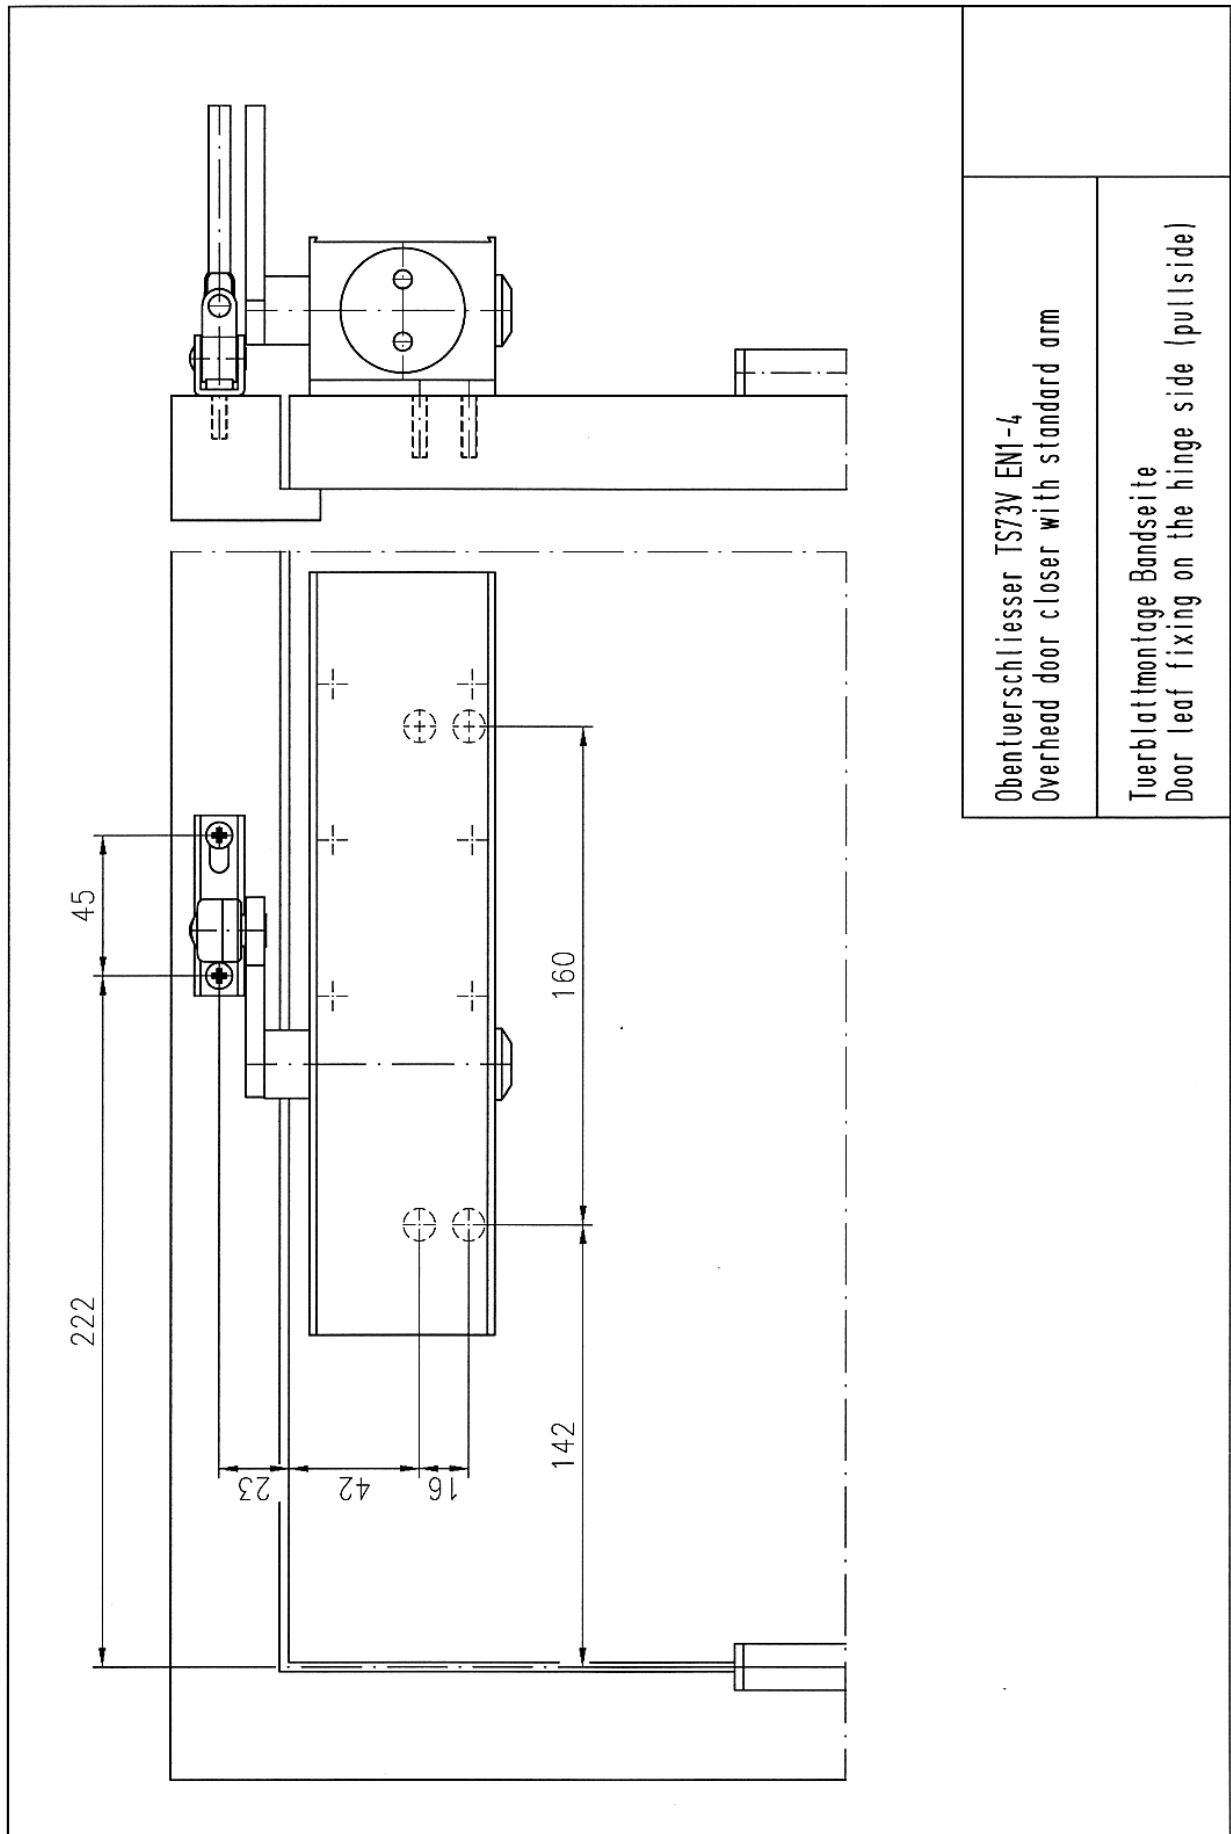

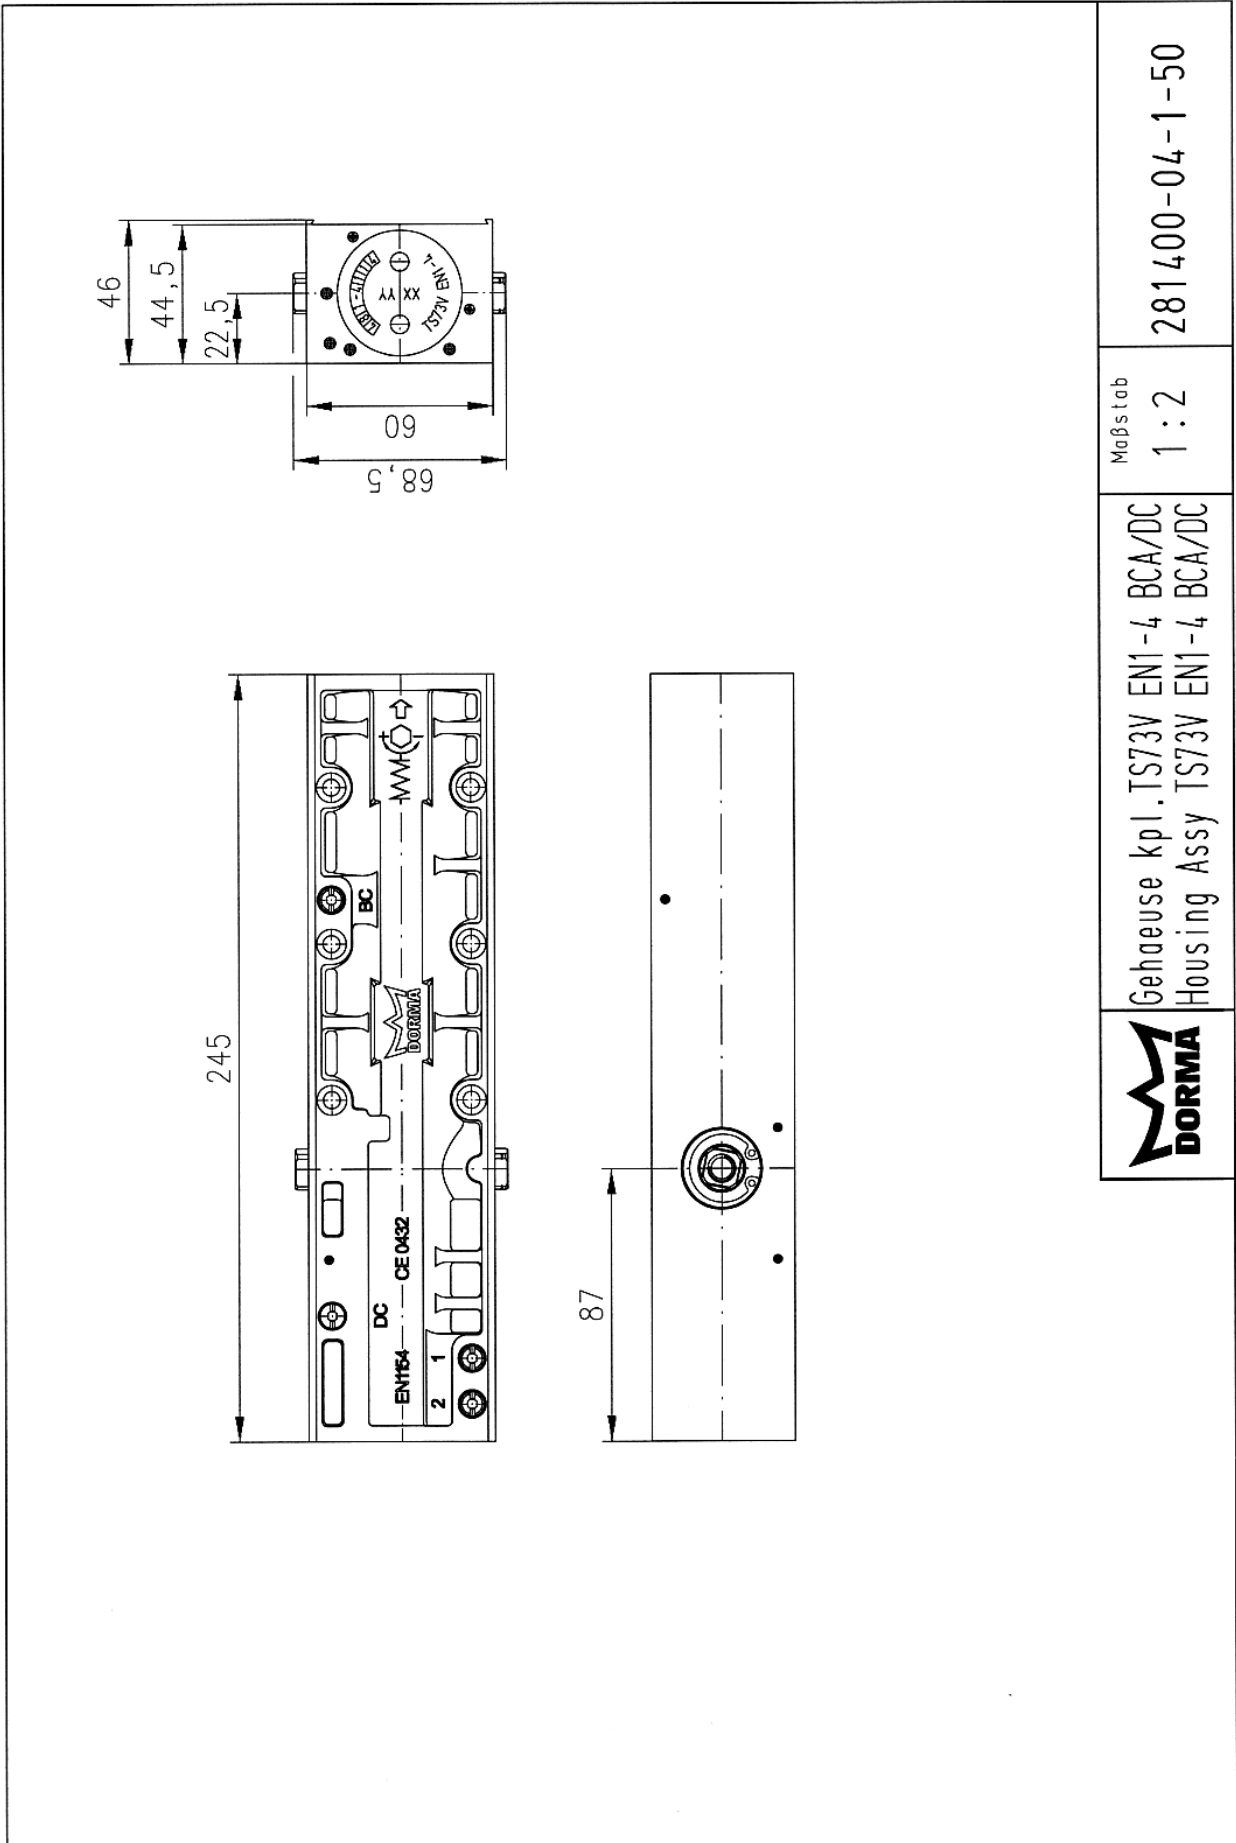

Maßstab	1 : 2	Gehäuse kpl. TS73V EN1-4 BCA/DC Housing Assy TS73V EN1-4 BCA/DC	281400-04-1-50
---------	-------	--	----------------

